# BAST-421C-BW2

### Wi-Fi BACnet®/IP Modulating Thermostat

The BASstat series of BACnet-compliant communicating thermostats provide effortless integration into BACnet/IP networks using a Wi-Fi connection. These thermostats are suited for modulated heating, cooling, and ventilation with analog output control in 4-pipe applications such as Fan Coil Units (FCU) or Air Handlers. A configurable control algorithm allows adaptability to the specific application. This adaptive control algorithm applied to modulated valve control saves energy and ensures comfort for the occupants. Three sensing options are available: built-in temperature sensor, input for remote temperature sensor, or temperature override network command from Building Automation System. Occupancy status can be set from thermostat buttons, a wired ESI input, or over the BACnet network. Thermostat buttons can be locked to prevent tampering. Digital display with graphical icons is easy to read and understand. Numerous icons indicate parameters such as: Active Mode, Cooling, Heating, Ventilation Only, Fan Active, Occupied/Unoccupied state. Two control types are available: Cooling and Heating with Auto-changeover and Cooling or Heating with Manual-changeover. NOTE: This unit is designed for 4-pipe HVAC systems and not recommended for 2-pipe HVAC systems.

### Installation

The BASstat requires **24 VAC** while drawing no more than 5 VA of power. The recommended conductor size is 16-18 AWG or 1.5mm<sup>2</sup> wires.

**WARNING:** Internally, this device utilizes a half-wave rectifier and therefore can only share the same AC power source with other half-wave rectified devices. Sharing AC power with full-wave rectified devices is NOT recommended. Devices powered from a common AC source could be damaged if a mix of half-wave and full-wave rectified devices exists.

BASstat mounts directly onto wall, panel, standard  $65 \times 65$ mm junction box (hole pitch 60 mm) or standard 2×4 inch vertical junction box (hole pitch 83.5 mm). To mount on electric box, separate back plate from the controller by loosening the screw. Align the mounting holes of the back plate to the screw holes of the electric box. Fix the back plate to the electric box using screws. Suggested screws for use are Phillips wide "truss head" or "washer head" screws #6-32 x <sup>3</sup>/<sub>4</sub>" (20mm). Wire the controller and mount on top of back plate. Secure by tightening the mount screw at the bottom.

**WARNING:** DO NOT let the back-mount screw heads rise above the back plate or it may touch the circuit board and cause a short.

CONTEMPORARY ONTRO

AC only

47-63 Hz

0°C to 50°C

Wi-Fi

-10°C to +60°C

5–95%, non-condensing

BACnet/IP Wi-Fi communication requires connecting to the thermostat as an access

24 V

5 VA

# **BASstat**

## Installation Guide

Electrical (Class 2 Circuits Only)

INPUT Voltage (±10%): Power: Frequency:

#### Environmental

Operating temperature: Storage temperature: Relative humidity:

#### Functional

Physical Layer: Wi-Fi range:




802.11b/g/n 150ft. as defined by the standard (depending on obstructions) 54Mbps max data rate

point for initial configuration. A Wi-Fi enabled laptop/computer or smart portable device can discover the BASstat initially as a Wi-Fi access point with SSID "*WiFi-122B-xxxx*" and no passphrase by default (simply click to connect to Access Point). The digits "*xxxx*" in "*122Bxxxx*" are the last 4 digits of the thermostat's Wi-Fi chip MAC address found written on the back side. This can assist when multiple Wi-Fi stats are installed (outlined in image below). Once connected to the thermostat, open its web page by typing **192.168.0.1** with **admin** for username and no password. Web page will be presented for network configuration. After initial connection, the Wi-Fi mode in the thermostat can be changed to *Infrastructure*, and the local Wi-Fi network configuration can be entered and stored. A reboot of the thermostat is required. Thanks to its EEPROM, the BASstat will store configuration in the event of power loss. If configuration fails or the thermostat needs to be configured to use a different Wi-Fi access point, the thermostat must be reset and reconfigured. Reset will restore all

values to default and can be selected from *Engineering Menu* (*rSt*).



**Operation Overview** 

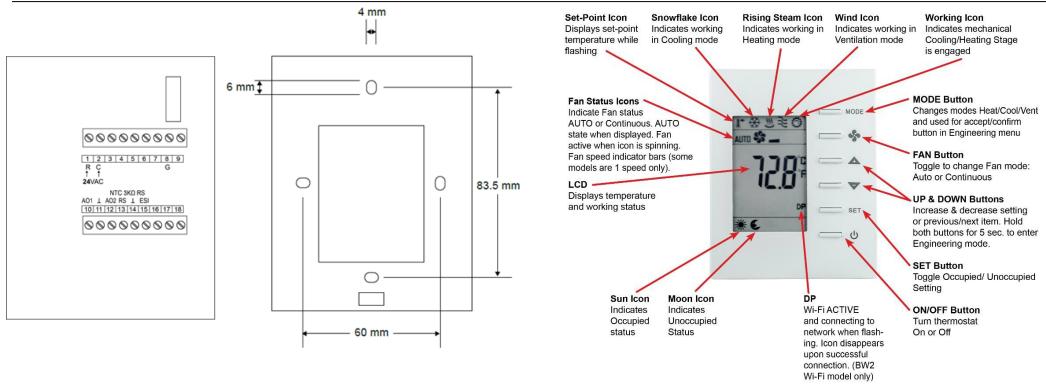

A unique *Device Instance* number throughout the entire BACnet network is required to distinguish the device from all other BACnet devices. When more than one BASstat is installed in the same network, their *Device Instance* numbers must be configured prior to connecting into the BACnet/IP network, or BACnet communication will fail due to the duplicate instance. Device instance can be modified in *Engineering Menu* items (*dEVH*) – high bytes – and (*dEVL*) – low bytes; *Device Instance* = (*dEVH*)\*1000+(*dEVL*).

To enter the Engineering Menu, press the UP and DOWN buttons simultaneously for 5 seconds. Use the UP and DOWN buttons to navigate through the menu and change menu item values. Use the MODE button to enter a menu item and accept/confirm a selected value. To exit the Engineering Menu, navigate to menu item (End) and press MODE. The menu will also exit automatically 10 seconds after the last button is pressed.

The BASstat has a built-in space temperature sensor with provision for remote wired 3kΩ NTC thermistor sensor, or temperature value can be sent by another device over the BACnet network. The default control type is *Cooling and Heating with Auto-changeover*. Two control types are available: Cooling and Heating with Auto-changeover and Cooling or Heating with Manual-changeover. These control types are selectable from *Engineering Menu (tyPE)* or BACnet object *MSV7*. User-side comfort control is accomplished with six buttons – mode (*Heat, Cool*, or *Ventilation* – dependent on control type chosen from *Engineering Menu (tyPE)* or BACnet object *MSV7*, fan, raise, lower, set, and power. There is also an option to lock select buttons or all buttons on the thermostat. A large LCD display indicates setpoint, space temperature, and current mode of operation using graphical icons.

**Reset settings** can be performed from Engineering Menu item (rSt) which will reset all parameters including communication (MAC and Device Instance) and all control algorithm values back to factory-programmed defaults.

For complete datasheet and details on BASstat, support, or compliance information, please download our BASstat User Manual and Data Sheet at: <a href="https://www.ccontrols.com/basautomation/basstat.php">https://www.ccontrols.com/basautomation/basstat.php</a> Free BACnet Discovery Tool for configuration; <a href="https://www.ccontrols.com/sd/bdt.htm">https://www.ccontrols.com/basautomation/basstat.php</a>

Contemporary Control Systems, Inc. reserves the right to make changes in the specifications of the product described within this manual at any time without notice and without obligation of Contemporary Control Systems, Inc. to notify any person of such revision or change.

TD150935-0IB (€

O